

# IEEE Standard Inverse-Time Characteristic Equations for Overcurrent Relays

Sponsor  
**Power System Relaying Committee  
of the  
IEEE Power Engineering Society**

Reaffirmed 2 May 2002  
Approved 27 1997

**American National Standards Institute**

Reaffirmed 6 December 2001  
Approved 19 September 1996

**IEEE Standards Board**

**Abstract:** The inverse-time characteristics of overcurrent relays are defined in this standard. Operating equations and allowances are provided in the standard. The standard defines an integral equation for microprocessor relays that ensures coordination not only in the case of constant current input but for any current condition of varying magnitude. Electromechanical inverse-time overcurrent relay reset characteristics are defined in the event that designers of microprocessor based relays and computer relays want to match the reset characteristics of the electromechanical relays.

**Keywords:** inverse-time characteristics, overcurrent relays

---

The Institute of Electrical and Electronics Engineers, Inc.  
345 East 47th Street, New York, NY 10017-2394, USA

Copyright © 1997 by the Institute of Electrical and Electronics Engineers, Inc.

All rights reserved. Published 1997. Printed in the United States of America

ISBN 1-55937-887-5

**IEEE Standards** documents are developed within the IEEE Societies and the Standards Coordinating Committees of the IEEE Standards Board. Members of the committees serve voluntarily and without compensation. They are not necessarily members of the Institute. The standards developed within IEEE represent a consensus of the broad expertise on the subject within the Institute as well as those activities outside of IEEE that have expressed an interest in participating in the development of the standard.

Use of an IEEE Standard is wholly voluntary. The existence of an IEEE Standard does not imply that there are no other ways to produce, test, measure, purchase, market, or provide other goods and services related to the scope of the IEEE Standard. Furthermore, the viewpoint expressed at the time a standard is approved and issued is subject to change brought about through developments in the state of the art and comments received from users of the standard. Every IEEE Standard is subjected to review at least every five years for revision or reaffirmation. When a document is more than five years old and has not been reaffirmed, it is reasonable to conclude that its contents, although still of some value, do not wholly reflect the present state of the art. Users are cautioned to check to determine that they have the latest edition of any IEEE Standard.

Comments for revision of IEEE Standards are welcome from any interested party, regardless of membership affiliation with IEEE. Suggestions for changes in documents should be in the form of a proposed change of text, together with appropriate supporting comments.

Interpretations: Occasionally questions may arise regarding the meaning of portions of standards as they relate to specific applications. When the need for interpretations is brought to the attention of IEEE, the Institute will initiate action to prepare appropriate responses. Since IEEE Standards represent a consensus of all concerned interests, it is important to ensure that any interpretation has also received the concurrence of a balance of interests. For this reason, IEEE and the members of its societies and Standards Coordinating Committees are not able to provide an instant response to interpretation requests except in those cases where the matter has previously received formal consideration.

Comments on standards and requests for interpretations should be addressed to:

Secretary, IEEE Standards Board  
445 Hoes Lane  
P.O. Box 1331  
Piscataway, NJ 08855-1331  
USA

Note: Attention is called to the possibility that implementation of this standard may require use of subject matter covered by patent rights. By publication of this standard, no position is taken with respect to the existence or validity of any patent rights in connection therewith. The IEEE shall not be responsible for identifying all patents for which a license may be required by an IEEE standard or for conducting inquiries into the legal validity or scope of those patents that are brought to its attention.

Authorization to photocopy portions of any individual standard for internal or personal use is granted by the Institute of Electrical and Electronics Engineers, Inc., provided that the appropriate fee is paid to Copyright Clearance Center. To arrange for payment of licensing fee, please contact Copyright Clearance Center, Customer Service, 222 Rosewood Drive, Danvers, MA 01923 USA; (508) 750-8400. Permission to photocopy portions of any individual standard for educational classroom use can also be obtained through the Copyright Clearance Center.

## Introduction

(This introduction is not part of IEEE Std C37.112-1996, IEEE Standard Inverse-Time Characteristic Equations for Overcurrent Relays.)

Induction overcurrent relay characteristics have been in continuous use for over 40 years and are a de facto standard in North America. When an overcurrent relay is installed in North America, it often must coordinate with existing induction relays and fuses. Induction characteristics appear in the form of stored data tables, polynomials, or spline curves in most relay coordination programs. There has been no previous defining standard and all the relay curve data was obtained from characteristics plotted from experimental data. Conversely, microprocessor relays execute algorithms that are mathematical procedures. They produce analytic characteristics that can be described accurately by an equation. This standard bridges the gap between the previous graphical practices and the present analytical practices. This is done by defining equations that ensure that microprocessor overcurrent relays will coordinate with induction overcurrent relays. The standard defines equations for the reset region as well as for the trip region of the time-current characteristic that are derived from the basic differential equation for input-dependent time delay as it applies to the induction relay.

This standard was developed by the Standard for Inverse-Time Characteristics Working Group of the Relay Standards Subcommittee of the Power System Relaying Committee. The working group membership at the time of completion of this standard was as follows:

**G. Benmouyal, Chair**  
**M. Meisinger, Vice Chair**

J. Burnworth  
W. A. Elmore  
K. Friedrich  
P. A. Kotos  
P. R. Leblanc

P. J. Lerley  
J. E. McConnell  
J. Mizener  
J. Pinto de Sa  
R. Ramaswami

M. S. Sachdev  
W. M. Strang  
J. E. Waldron  
S. Watanasiroch  
S. E. Zocholl

At the time of the completion of this standard the members of the Relay Standards Subcommittee were as follows:

**R. W. Haas, Chair**  
**M. Sanders, Vice Chair**

B. Beckwith  
G. Benmouyal  
J. W. Chadwick, Jr.  
G. K. Clough  
C. J. Cook  
C. L. Downs  
W. A. Elmore  
D. W. Hawver

P. A. Kotos  
J. R. Linders  
W. M. Mello  
B. D. Nelson  
K. J. Khunkhun  
W. J. Marsh  
M. J. McDonald  
M. Meisinger

A. G. Phadke  
M. Sachdev  
T. S. Sidhu  
M. Swanson  
E. A. Udren  
V. Varneckas  
C. L. Wagner  
T. E. Wiedman

At the time this standard was completed, the IEEE Power System Relaying Committee had the following membership:

**A. T. Giulliante, Chair**  
**J. C. Appleyard, Vice Chair**  
**R. W. Dempsey, Secretary**

M. Adamiak  
E. A. Baumgartner  
B. L. Beckwith  
R. W. Beckwith

G. Benmouyal  
D. C. Blackburn  
J. R. Boyle  
B. Bozoki

J. Burnworth  
H. J. Calhoun  
C. H. Castro  
T. W. Cease

J. W. Chadwick, Jr.  
G. K. Clough  
S. P. Conrad  
M. Conroy  
C. J. Cook  
A. N. Darlington  
D. C. Dawson  
C. L. Downs  
P. R. Drum  
L. L. Dvorak  
W. A. Elmore  
M. K. Enns  
J. Esztergalyos  
G. Farley  
C. W. Fromen  
S. E. Grier  
E. N. Gulachenski  
E. A. Guro  
R. W. Haas  
R. E. Hart  
C. F. Henville  
J. W. Hohn  
S. H. Horowitz  
J. D. Huddleston, III  
J. W. Ingleson

J. A. Jodice  
E. W. Kalkstein  
T. L. Kaschalk  
M. Kezunovic  
K. J. Khunkhun  
W. C. Kotheimer  
P. Kotos  
J. R. Latham  
J. R. Linders  
W. J. Marsh, Jr.  
J. McConnell  
M. J. McDonald  
J. McElray  
M. Meisinger  
W. Mello  
R. J. Moran  
C. J. Mozina  
T. J. Murray  
K. K. Mustaphi  
G. R. Nail  
B. D. Nelson  
S. L. Nilsson  
G. C. Parr  
R. D. Pettigrew  
A. G. Phadke

A. C. Pierce  
J. M. Postforoosh  
M. S. Sachdev  
E. T. Sage  
M. Sanders  
M. P. Sanders  
D. Smaha  
J. E. Stephens  
W. M. Strang  
F. Y. Tajaddodi  
R. P. Taylor  
J. T. Tengdin  
J. S. Thorp  
D. A. Tziouvaras  
E. A. Udren  
V. Varneckas  
C. L. Wagner  
J. W. Walton  
W. P. Waudby  
T. E. Wiedman  
P. B. Winston  
K. V. Zimmerman  
J. A. Zipp  
S. E. Zocholl  
J. A. Zulaski

The following persons were on the balloting committee:

M. Adamiak  
J. Appleyard  
E. A. Baumgartner  
B. L. Beckwith  
R. W. Beckwith  
G. Benmouyal  
D. C. Blackburn, Jr.  
J. Boyle  
B. Bozoki  
J. A. Bright  
J. Burnworth  
H. J. Calhoun  
C. H. Castro  
T. W. Cease  
J. W. Chadwick, Jr.  
S. R. Chano  
G. Clough  
S. P. Conrad  
M. W. Conroy  
C. J. Cook  
A. N. Darlington  
D. C. Dawson  
R. W. Dempsey  
C. L. Downs  
P. R. Drum  
L. L. Dvorak

W. Elmore  
A. Elnewehi  
J. Esztergalyos  
H. G. Farley  
E. C. Fennell  
C. W. Fromen  
J. D. Gardell  
J. G. Gilbert  
A. T. Giuliante  
S. E. Grier  
E. M. Gulachenski  
E. A. Guro  
R. W. Haas  
R. E. Hart  
I. Hasenwinkle  
C. Henville  
J. W. Hohn  
J. D. Huddleston, III  
J. W. Ingleson  
J. A. Jodice  
E. W. Kalkstein  
M. Kezunovic  
K. J. Khunkhun  
W. C. Kotheimer  
P. A. Kotos  
J. R. Linders

W. J. Marsh Jr  
J. E. McConnell  
M. J. McDonald  
J. L. McElray  
M. Meisinger  
W. M. Mello  
R. J. Moran  
C. J. Mozina  
K. K. Mustaphi  
G. R. Nail  
B. D. Nelson  
G. C. Parr  
R. D. Pettigrew  
A. G. Phadke  
A. C. Pierce  
J. M. Postforoosh  
M. S. Sachdev  
E. T. Sage  
M. P. Sanders  
J. E. Stephens  
W. M. Strang  
M. J. Swanson  
R. P. Taylor  
J. Teague  
J. T. Tengdin  
J. S. Thorp

D. A. Tziouvaras  
J. T. Uchiyama  
E. A. Udren  
V. Varneckas

C. L. Wagner  
W. P. Waudby  
T. E. Wiedman  
P. B. Winston

K. Zimmerman  
J. A. Zipp  
S. Zocholl  
J. A. Zulaski

When the IEEE Standards Board approved this standard on 19 September 1996, it had the following membership:

**Donald C. Loughry**, *Chair*  
**Richard J. Holleman**, *Vice Chair*  
**Andrew G. Salem**, *Secretary*

Gilles A. Baril  
Clyde R. Camp  
Joseph A. Cannatelli  
Stephen L. Diamond  
Harold E. Epstein  
Donald C. Fleckenstein  
Jay Forster\*  
Donald N. Heirman  
Ben C. Johnson

E. G. "Al" Kiener  
Joseph L. Koepfinger\*  
Stephen R. Lambert  
Lawrence V. McCall  
L. Bruce McClung  
Marco W. Migliaro  
Mary Lou Padgett  
John W. Pope  
Jose R. Ramos

Arthur K. Reilly  
Ronald H. Reimer  
Gary S. Robinson  
Ingo Rüsçh  
John S. Ryan  
Chee Kiow Tan  
Leonard L. Tripp  
Howard L. Wolfman

\*Member Emeritus

Also included are the following nonvoting IEEE Standards Board liaisons:

Satish K. Aggarwal

Alan H. Cookson

Chester C. Taylor

Rochelle L. Stern  
*IEEE Standards Project Editor*

CLAUSE	PAGE
1. Overview .....	1
1.1 Scope .....	1
1.2 Purpose .....	1
2. References .....	1
3. Definitions .....	2
4. The time-current equation .....	2
4.1 Coordination of inverse time-current characteristics .....	2
4.2 The analytic equation .....	2
4.3 Time dial .....	4
4.4 Standard time-current characteristics .....	4
Annex A Derivation of the induction characteristic (Informative) .....	7
Annex B Bibliography (Informative) .....	13

# IEEE Standard Inverse-Time Characteristic Equations for Overcurrent Relays

## 1. Overview

### 1.1 Scope

The scope of this standard includes the review of various existing analytic techniques used to represent relay operating characteristic curve shapes and proposes analytical (formula) representation of typical operating characteristic curve shapes to foster some standardization of available inverse-time relay characteristics provided in microprocessor or computer relay applications.

### 1.2 Purpose

The purpose of this standard is to provide an analytic (formula) representation of typical relay operating characteristic curve shapes of various inverse-time relays to facilitate representation by microprocessor-type relays and promote a degree of standardization in the inverse shape of a selected curve.

## 2. References

This standard shall be used in conjunction with the following publications. If the following publications are superseded by an approved revision, the revision shall apply.

IEC Publication 255-3 (1989-05), Single input energizing quantity measuring relays with dependent or independent time, Second Edition.<sup>1</sup>

IEEE Std C37.90-1989 (R1994), IEEE Standard for Relays and Relay Systems Associated with Electric Power Apparatus (ANSI).<sup>2</sup>

<sup>1</sup>IEC publications are available from IEC Sales Department, Case Postale 131, 3, rue de Varembe, CH-1211, Genève 20, Switzerland/Suisse. IEC publications are also available in the United States from the Sales Department, American National Standards Institute, 11 West 42nd Street, 13th Floor, New York, NY 10036, USA.

<sup>2</sup>IEEE publications are available from the Institute of Electrical and Electronics Engineers, 445 Hoes Lane, P.O. Box 1331, Piscataway, NJ 08855-1331, USA.

### 3. Definitions

**3.1 inverse-time overcurrent relay:** A current operated relay that produces an inverse time-current characteristic by integrating a function of current  $F(I)$  with respect to time. The function  $F(I)$  is positive above and negative below a predetermined input current called the pickup current. Pickup current is therefore the current at which integration starts positively and the relay produces an output when the integral reaches a predetermined positive set value.

For the induction relay, it is the disk velocity that is the function of current  $F(I)$  that is integrated to produce the inverse-time characteristic. The velocity is positive for current above and negative for current below a predetermined pickup current. The predetermined set value of the integral represents the disk travel, required to actuate the trip output.

**3.2 reset:** The state of an inverse-time overcurrent relay when the integral of the function of current  $F(I)$  that produces a time-current characteristic is zero.

**3.3 reset characteristics:** The time vs. current curve that defines the time required for the integral of the function of current  $F(I)$  to reach zero for values below current pickup when the integral is initially at the trip value.

**3.4 time dial:** The time dial is the control that determines the value of the integral at which the trip output is actuated, and hence controls the time scale of the time-current characteristic produced by the relay. In the induction-type relay, the time dial sets the distance the disk must travel, which is the integral of the velocity with respect to time.

## 4. The time-current equation

### 4.1 Coordination of inverse time-current characteristics


Coordination practice is influenced by the type of grounding used in distribution systems. Notably, in Europe and Japan the practice is to operate impedance grounded or ungrounded relatively short three-wire primary distribution systems. Since there are no single-phase laterals protected by fuses, coordination can be achieved using definite-time characteristics. In North America the practice is to operate grounded four-wire distribution systems with loads served by single-phase laterals protected by fuses. As a result, coordination is obtained using inverse time-current characteristics suitable for fuse coordination. Figure 1 shows the close coordination of an extremely inverse induction characteristic with a high-voltage fuse.

The straight line  $I^2t$  log-log plot of a fuse minimum melting time is often visualized as the basic time-current characteristic. However, a definite time must be added to emulate the maximum clearing time of the fuse. This illustrates the fundamental concept that whenever fixed clearing time is added to a straight line log-log plot, the result is a curve. For this reason, the best shape for a time-current characteristic for coordination purposes is the curve formed when a definite time is added to the straight line of a log-log plot.

### 4.2 The analytic equation

Equations (1) and (2) define the reset time and pickup time of an inverse-time overcurrent curve as shown in annex A. By applying the constants to these equations, a characteristic curve can be accurately defined. Equation (2) is similar to the IEC equation (see IEC 255-03 [1989-05]) except for the addition of constant B. The constant B defines the definite time component that is the result of core saturation of an induction type relay.



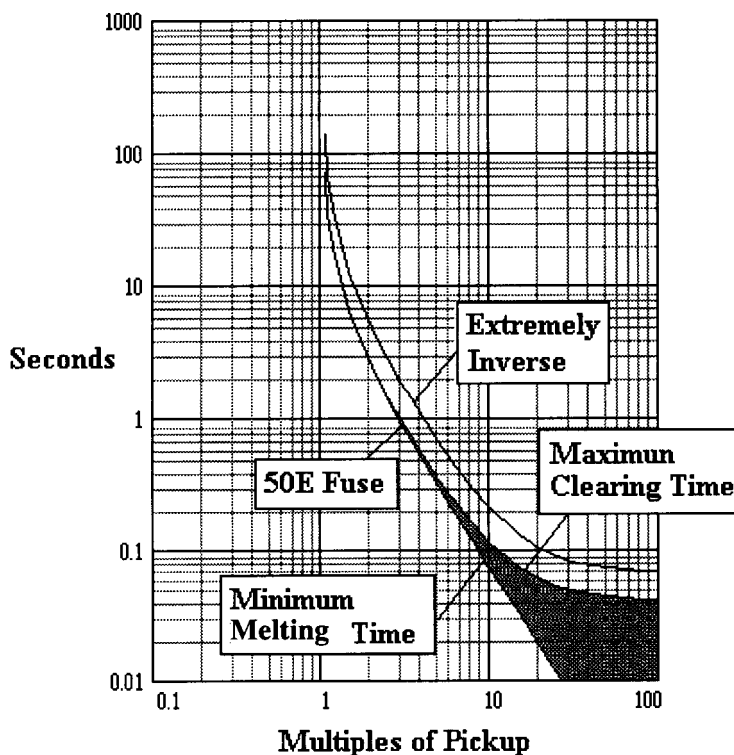

**Figure 1 – Extremely inverse characteristic compared with minimum melting and maximum clearing time of a 50E fuse**

For  $0 < M < 1$

$$t(I) = \left( \frac{t_r}{M^2 - 1} \right) \tag{1}$$

For  $M > 1$

$$t(I) = \left( \frac{A}{M^p - 1} + B \right) \tag{2}$$

where

- $t(I)$  is the reset time in equation (1) and the trip time equation (2) in seconds
- $M$  is the  $I_{input}/I_{pickup}$  ( $I_{pickup}$  is the relay current set point)
- $t_r$  is the reset time (for  $M = 0$ )
- $A, B, p$  constants to provide selected curve characteristics

Induction relays have a dynamic property that results in a higher rate of disk travel with higher current. Typically, faulted conditions may present the relay with a variable fault current prior to the relay tripping. Equation (3) emulates the dynamics of the induction disk inverse-time overcurrent relay and therefore coordination will be maintained even with varying current.

$$\int_0^{T_0} \frac{1}{t(I)} dt = 1 \tag{3}$$

where

$T_0$  is the operating time

### 4.3 Time dial

The time dial of an overcurrent relay is a control that permits the characteristic of the relay to be adjusted to a predetermined trip time at a specified current. The time dial generally allows a 15 to 1 range of time adjustment. In the characteristic equations (1) and (2), the constants  $A$ ,  $B$ , and  $t_r$  are varied proportionally with time dial. Whereas the ratio of  $A$  to  $B$  may vary to some extent with the time dial setting in induction relays, the ratio of  $A$  to  $B$  remains constant in microprocessor relays.

### 4.4 Standard time-current characteristics

The constants and exponents in table 1 when used in equations (1) and (2) define the shape of the standard Moderately Inverse, Very Inverse, and Extremely Inverse trip characteristics. The constant  $t_r$ , when used in equation (1) defines the optional reset characteristic. These constants define the curve near the middle of the time dial range and represents the mean curve of the induction characteristics defined in annex A.

**Table 1—Constants and exponents for standard characteristics\***

Characteristic	A	B	$p$	$t_r$
Moderately inverse	0.0515	0.1140	0.020 00	4.85
Very inverse	19.61	0.491	2.0000	21.6
Extremely inverse	28.2	0.1217	2.0000	29.1

\*For the specified range of  $M$ , the number of digits represented for each constant is such that a unit change in the least significant digit will cause a change no greater than 0.5% in the subsequent computation of the relative time change ( $\Delta t/t$ ).

The characteristics of a microprocessor-based protective relay conform to this standard when they are implemented according to equation (3), where  $t(I)$  is given by equation (2) and the trip time values corresponding to values in the range of 1.5 to 20 multiples of the pickup current are within the conformance bands shown in figures 2, 3, and 4. The upper and lower limits of the conformance bands are 1.15 and 0.85 times the characteristic defined in table 1. The conformance band for the optional reset characteristic extends from 0.05 to 0.9 multiples of pickup current. The conformance bands are templates for classifying the shape of standard inverse-time current characteristics and are not tolerance bands for accuracy or repeatability.

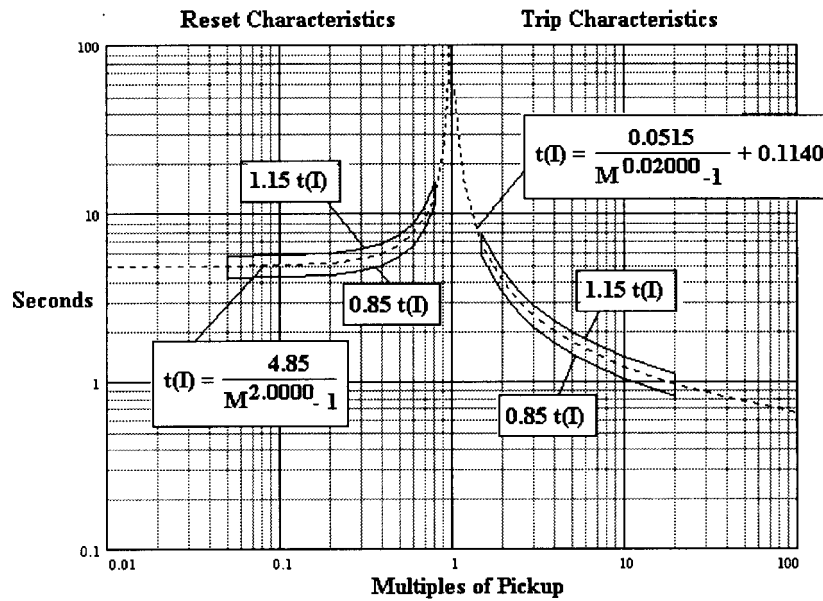


Figure 2—Standard moderately inverse time-current characteristic with standard conformance band near the middle of the time dial range

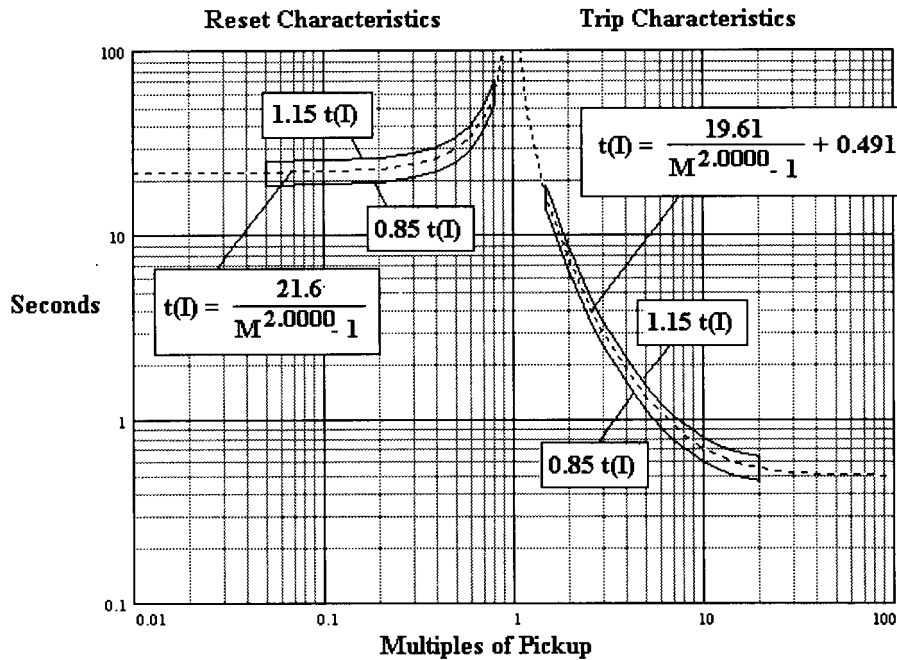


Figure 3—Standard very inverse time-current characteristic with standard conformance band near the middle of the time dial range

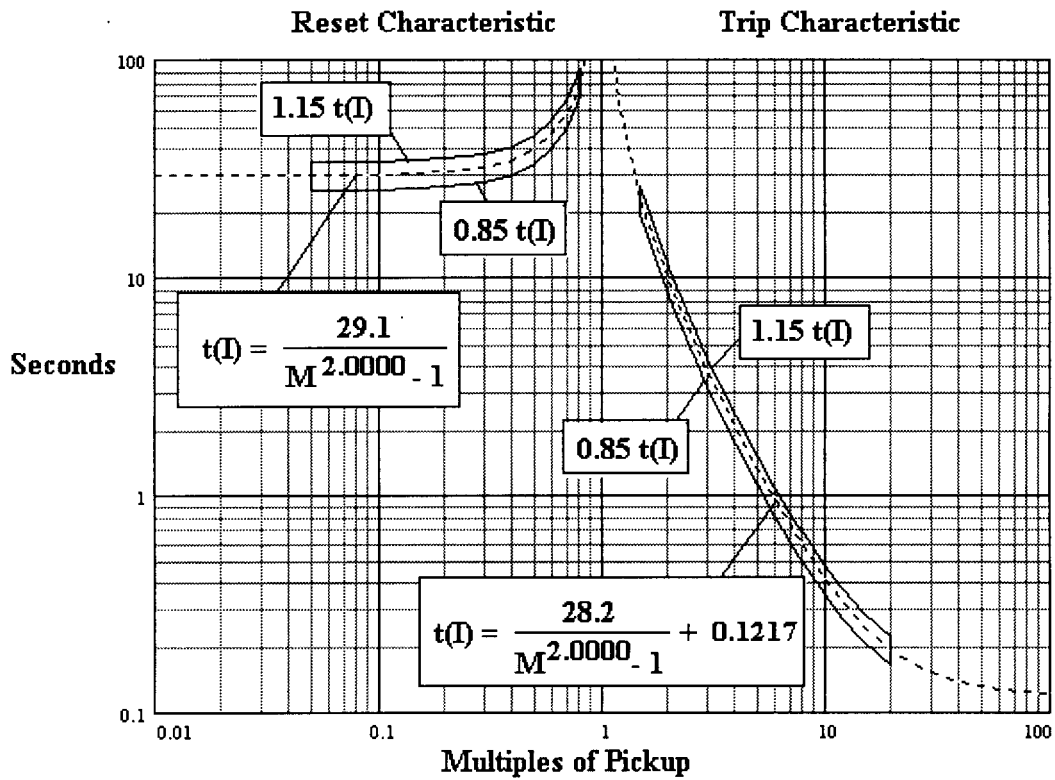


Figure 4—Standard extremely inverse time-current characteristic with standard conformance band near the middle of the time dial range

## Annex A

### Derivation of the induction characteristic (Informative)

#### A.1 The time-current equation

The analytic equation that defines the inverse time-current characteristic is derived from the basic differential equation for input dependent time delay as it applies to an induction relay as follows:

$$K_I I^2 = m \frac{d^2\theta}{dt^2} + K_d \frac{d\theta}{dt} + \frac{\tau_F - \tau_S}{\theta_{\max}} \theta + \tau_S \quad (\text{A.1})$$

where

$I$	is the input current
$\theta$	is the disk travel
$\theta_{\max}$	is the maximum disk travel
$K_I$	is a constant relating torque to current
$m$	is the moment of inertia of the disk
$K_d$	is the drag magnet damping factor
$\tau_F$	is the spring torque at maximum travel
$\tau_S$	is the initial spring torque

The gradient of the torsion spring used in the induction relay is small and results in only a small increase in torque from  $\tau_S$  to  $\tau_F$  with travel. The disk is also shaped to produce an increasing torque with travel to offset the increase in spring torque. The resulting net disk torque is as follows:

$$K_I I^2 - \tau_S \quad (\text{A.2})$$

where the constant torque  $\tau_S$  determines pickup. Let the current  $I$  equal  $M$  multiples of the pickup current  $I_p$  so that the net torque may be written as follows:

$$K_I (M I_p)^2 - \tau_S \quad (\text{A.3})$$

At pickup  $M = 1$  and the net torque on the disk is zero:

$$\begin{aligned} K_I I_p^2 - \tau_S &= 0 \\ K_I I_p^2 &= \tau_S \end{aligned} \quad (\text{A.4})$$

The net torque can then be expressed in terms of the spring torque by substituting equation (A.4) into equation (A.3) as follows:

$$(M^2 - 1)\tau_S \quad (\text{A.5})$$

By neglecting the small moment of inertia of the disk, equation (A.1) is simplified to

$$\tau_S (M^2 - 1) = K_d \frac{d\theta}{dt} \quad (\text{A.6})$$

The solution of this equation, which now lacks the second-order term, has the result that there is no acceleration or deceleration time. This means that, in this representation, final velocity is reached in a negligible period of time, and also that there is negligible overtravel. This simplification is valid in most applications. Integrating equation (A.6) gives

$$\theta = \int_0^{T_0} \frac{\tau_s}{K_d} (M^2 - 1) dt \quad (\text{A.7})$$

dividing both sides of equation (A.7) by  $\theta$  gives the dynamic equation:

$$\int_0^{T_0} \frac{\tau_s}{K_d \theta} (M^2 - 1) dt = \int_0^{T_0} \frac{1}{t(I)} dt = 1 \quad (\text{A.8})$$

where  $t(I)$  is the time current characteristic and the constant  $A$  equals  $K_d \theta / \tau_s$ :

$$t(I) = \frac{\left( \frac{K_d \theta}{\tau_s} \right)}{(M^2 - 1)} = \frac{A}{(M^2 - 1)} \quad (\text{A.9})$$

## A.2 The reset characteristic

In some applications it may be an advantage to reset the time integral in one cycle. However, optional reset characteristics should also be provided when required for reset coordination with existing induction relays.

Equation (A.9) defines the induction characteristic for currents both below and above the pickup current. If an induction disk has an initial displacement from its reset position when the applied current is reduced to zero, the disk will be driven in a negative direction toward the reset position. This is represented in equation (A.9) by setting  $M = 0$ , which produces a negative number indicating the reset time and the rotation of the disk in the direction toward reset. With this substitution, equation (A.9) gives the reset time  $t_r$ :

$$|t_r| = \frac{K_d \theta}{\tau_s} \quad (\text{A.10})$$

and the reset characteristic for any value of  $M$  between zero and one is

$$t = \frac{t_r}{M^2 - 1} \quad (\text{A.11})$$

The dynamic equation (A.8) and the characteristic equation (A.9) are important since they specify how an inverse time-current characteristic must be implemented in order to assure coordination with existing inverse-time overcurrent relays under all conditions of varying current such as decreasing fault resistance and remote terminal clearing.

## A.3 Curves shaped by saturation

The torque due to current is proportional to the square of the flux caused by the current, and the previous derivation assumes a linear relation between the flux and the current. It does not take into account the saturation of the electromagnet that is used to shape the time-current characteristics produced by the induction principle. The degree of saturation used to produce a particular curve can be determined by substituting the normalized flux for  $M$  in equation (A.11):

$$t = \frac{t_r}{\left(\frac{\phi}{\phi_{pu}}\right)^2 - 1} \quad (\text{A.12})$$

where

$\phi/\phi_{pu}$  is the normalized flux  
 $t_r$  is the reset time for  $I = 0$   
 $t$  is the time to operate

From equation (A.12) the normalized flux in terms of the operating and reset time is

$$\left(\frac{\phi}{\phi_{pu}}\right) = \sqrt{\frac{t_r}{t} + 1} \quad (\text{A.13})$$


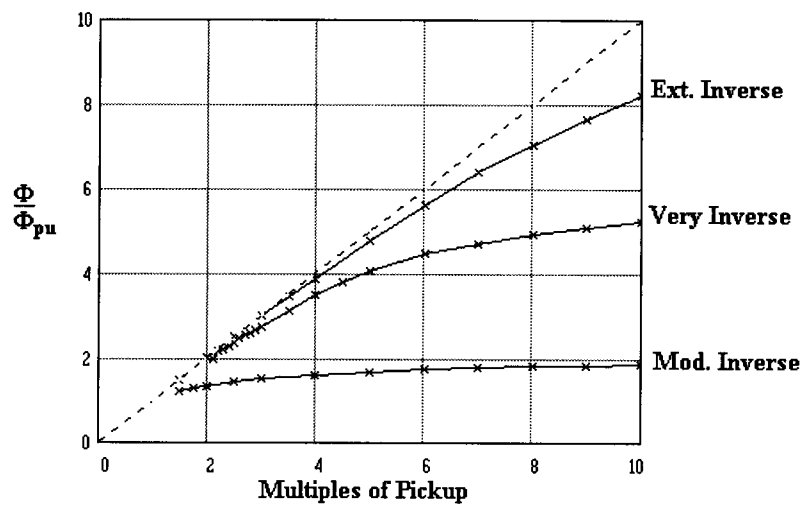


Figure A-1—Normalized flux in extremely inverse, very inverse, and moderately inverse relays

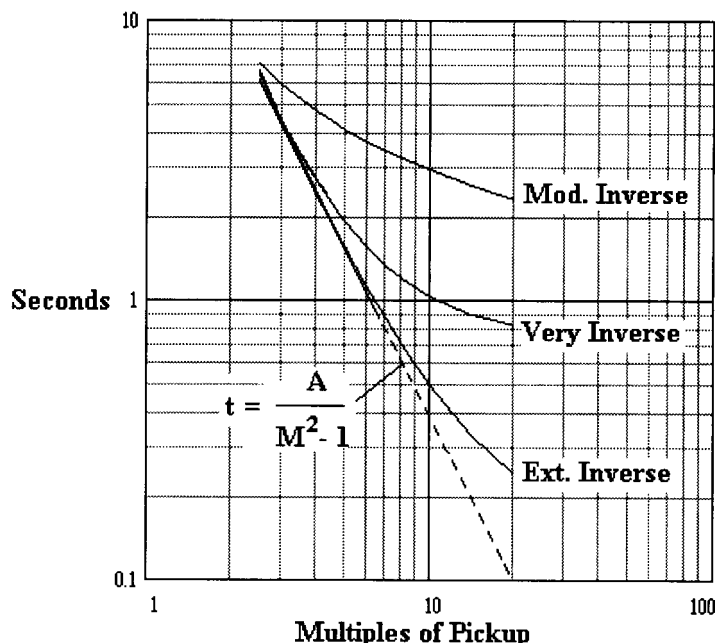

**Figure A-2—Comparison of extremely, very, and moderately inverse characteristics**

The normalized flux vs.  $M$  multiples of pickup can be determined by setting  $t_r$  equal to the total reset time with zero current and then substituting values of operating time corresponding to various multiples of pickup current. Plots of normalized flux for an extremely inverse, a very inverse, and a moderately inverse induction-type overcurrent relay are shown in figure A-1 and the resulting characteristics are compared in figure A-2. The plot shows the electromechanical technique uses specific degrees of saturation to produce the familiar time-current characteristic and shows the following order. The extremely inverse relay saturates at four multiples of pickup, the very inverse at two multiples (half the previous value), and the moderately inverse at pickup (again, half the previous value).

The derivation shows that the induction characteristic, were it not for the deliberate saturation, is the straight line log-log characteristic of a fuse. However, the curve is formed by saturating the electromagnet at a specific multiple of pickup current. It has also been shown that saturation is the means that, in effect, incorporates the definite time component to form a practical curve for coordination. Therefore, adding a constant definite time term to equation (A.9) forms the induction characteristic equation

$$t = \frac{A}{M^2 - 1} + B \quad (\text{A.14})$$

The constants  $A$  and  $B$  can be chosen to emulate accurately the extremely and very inverse induction time-current characteristics. An accurate emulation of the moderately inverse characteristic can be made by changing the exponent from 2 to 0.02 with specific values for  $A$  and  $B$ . Equation (A.14) is the trip characteristic equation that emulates the saturation occurring for currents above pickup. However, the reset characteristic remains equation (A.11) since saturation does not occur at currents below the pickup current. The constants  $A$  and  $B$  and exponent  $p$  determine the curve shape of the trip characteristics. The constants for the number 5 dial of models of induction relay characteristics are listed in table A-1 and table A-2. A comparison of the moderately inverse, very inverse, and extremely inverse characteristics of tables A-1 and A-2 are shown in the log-log plots of figures A-3, A-4, and A-5. A factor of 1.4 has been used with model B in figure A-5 in order to give equal times at 5.0 per unit. According to the above derivation, the constant  $A$  is equal to the reset time. However, test data for Model A and Model B show there can be a difference between the constant  $A$  in the trip characteristic and the zero current reset time,  $t_r$ , as shown in table A-1 and A-2.



**Table A-1—Induction relay model A**


Curve type	<i>M</i>	<i>t</i> (seconds)	<i>A</i>	<i>B</i>	<i>p</i> <sup>*</sup>	<i>t<sub>r</sub></i> (seconds)
Moderately inverse	5.00	1.64	0.047	0.183	0.02	5.4
Very inverse	5.00	1.28	18.92	0.492	2.00	21
Extremely inverse	5.00	1.30	28.08	0.130	2.00	26.5

\*Exponent *p* = 2.00 for rest.

**Table A-2—Induction relay model B**

Curve type	<i>M</i>	<i>t</i> (seconds)	<i>A</i>	<i>B</i>	<i>p</i> <sup>*</sup>	<i>t<sub>r</sub></i> (seconds)
Moderately inverse	5.00	1.83	0.056	0.045	0.02	4.3
Very inverse	5.00	1.35	20.29	0.489	2.00	22.3
extremely inverse	5.00	0.92	20.33	0.181	2.00	22.7

\*Exponent *p* = 2.00 for reset.

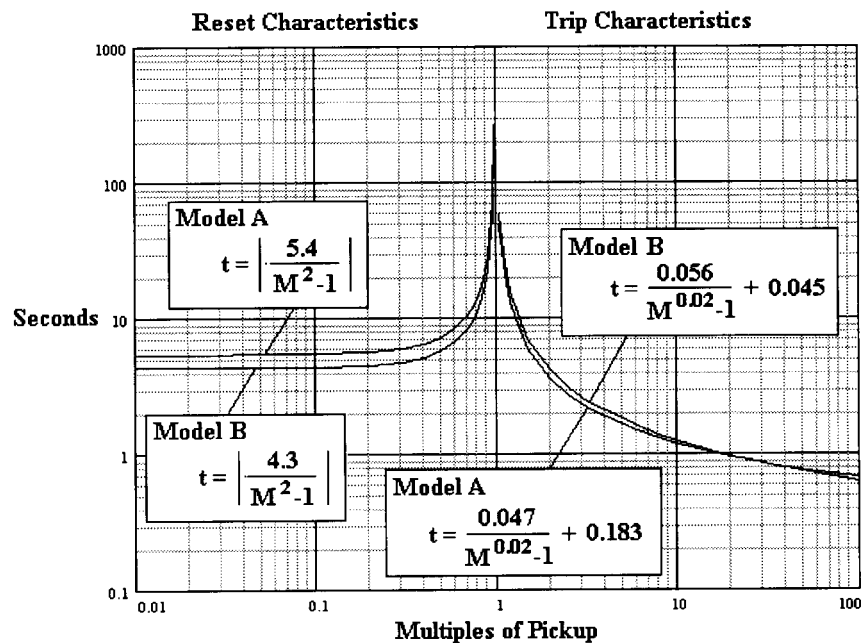

**Figure A-3—Moderately inverse time-current characteristic for two models of induction type overcurrent relays**

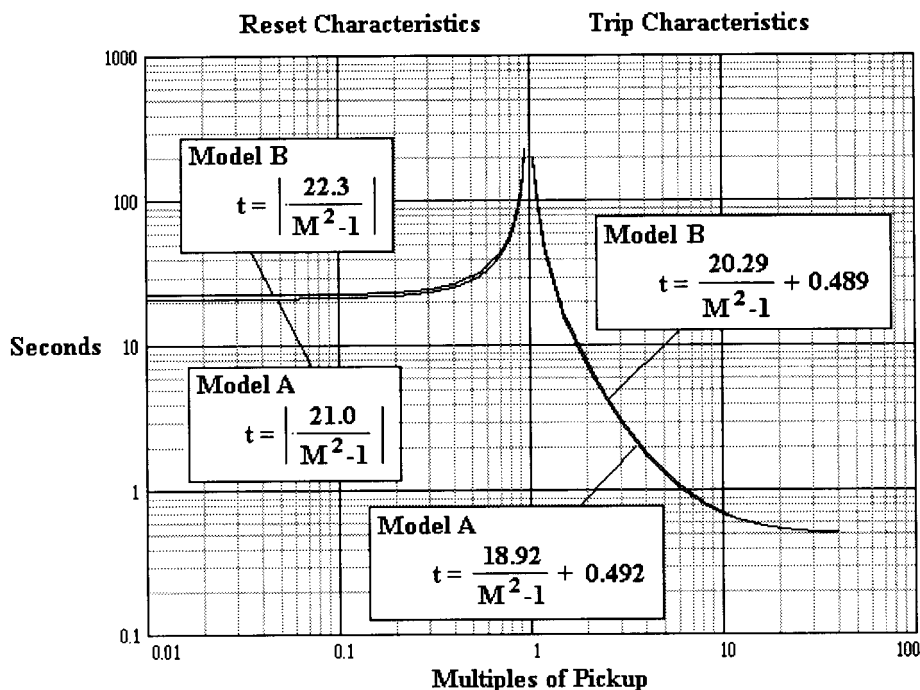


Figure A-4—Very inverse time-current characteristic for two models of induction type overcurrent relays

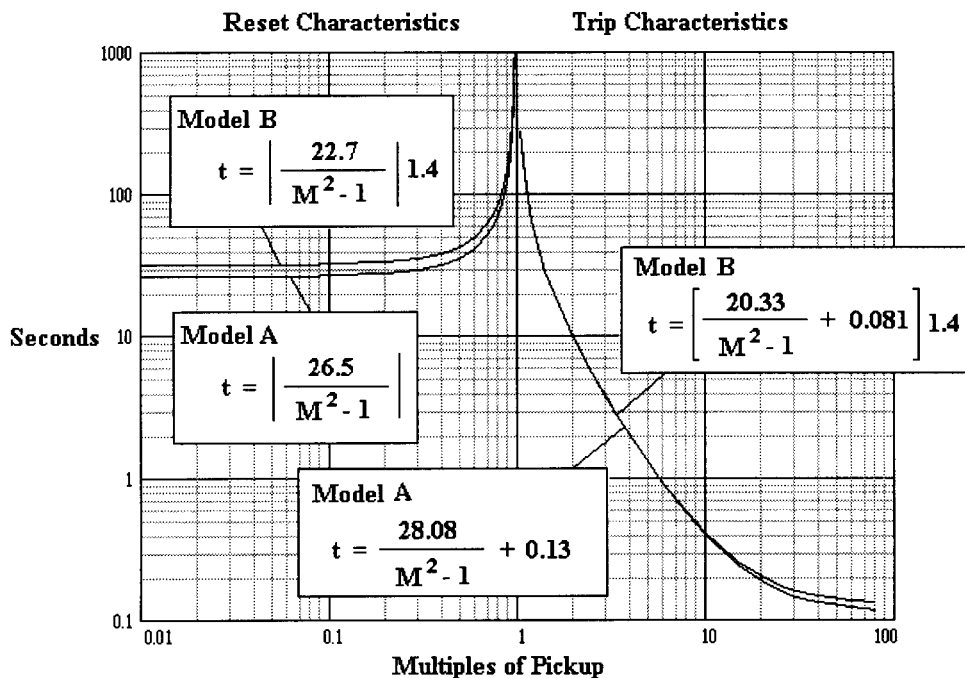


Figure A-5—Extremely inverse time-current characteristic for two models of induction type overcurrent relays

## Annex B

### Bibliography (Informative)

- [B1] Benmouyal, G., "Some Aspects of the Digital Implementation of Protection Time Functions," *IEEE Transactions on Power Delivery*, vol. 5, no. 4, Oct. 1990, pp. 1705–1713.
- [B2] Benmouyal, G. and Zocholl, S. E., "Testing Dynamic Characteristics of Overcurrent Relays," 20th Annual Western Relay Conference, Spokane WA, October 19–21, 1993.
- [B3] Carr J., and McCall, L. V., "Divergent Evolution and Resulting Characteristics Among the World's Distribution Systems," *IEEE Transactions on Power Delivery*, vol. 7, no. 3, July 1992, pp. 1601–1609.
- [B4] Elmore, W. A., Zocholl, S. E., and Kramer, C. A., "Effects of Wave Distortion on Protective Relays," *IEEE Transactions on Industry Applications*, vol. 29, no. 2, March/April 1993, pp. 404–411.
- [B5] Garrett, R., Kotheimer, W. C., and Zocholl, S. E., "Computer Simulation of Current Transformers and Relays for Performance Analysis," 14th Annual Western Relay Conference, Spokane, WA, Oct. 20–23, 1987.
- [B6] Glassburn, W. E. and Sonnemann, W. K., "Principles of Induction-Type Relay Design," *AIEE Transactions*, Part III, Power Apparatus and Systems, vol. 72, no. 4, Feb. 1953, pp. 23–27.
- [B7] IEEE Committee Report, "Computer Representation of Overcurrent Relay Characteristics," *IEEE Transactions on Power Delivery*, vol. 4, no. 2, July 1989, pp. 1659–1667.
- [B8] Kramer, C. A. and Elmore, W. A., "Flexible Inverse Overcurrent Relaying Using A Microprocessor," *IEEE Transactions on Power Delivery*, vol. 5, no. 2, April 1990, pp. 915–923.
- [B9] Sachdev, M. S., Singh, J., and Fleming, R. J., "Mathematical Models Representing Time-Current Characteristics of Overcurrent Relays for Computer Applications," *IEEE Power Engineering Society Winter Meeting*, New York, January/February 1978, Paper no. A 78 131-5, Publication, "Text of Papers 78 CH1295-5 PWR 131-5," pp. 1–8.
- [B10] Schweitzer, E. O. and Aliaga, A., "Digital Programmable Time-Parameter Relay Offers Versatility and Accuracy," *IEEE Transactions on Power Apparatus Systems*, no. 1, 1980.
- [B11] Singh, J., Sachdev, M. S., Fleming, R. J., and Krause, A. E., "Digital IDMT Overcurrent Relays," *Proceedings of the International Conference on Developments on Power System Protection*, 1980, IEE Publication no. 185, pp. 84–87.
- [B12] Warrington, A. R. Van C., *Protective relays: their theory and practice*, vol. I (chapter 4), John Wiley and Sons Inc., New York, 1962.
- [B13] Yalla, Murty V. V. S. and Smolinski, W. J., "Design and Implementation of a Versatile Digital Directional Overcurrent Relay," *Electric Power Systems Research*, vol. 18, no. 1, 1990, pp. 47–55.
- [B14] Zocholl, S. E., "Developing a Standard for Overcurrent Relay Characteristics," Georgia Tech Relay Conference, Atlanta, GA, May 1990.
- [B15] Zocholl, S. E., "Integrated Metering and Protective Relay Systems," *IEEE Transactions on Industry Applications*, vol. 25, no. 5, September/October 1989, pp. 889–893.